
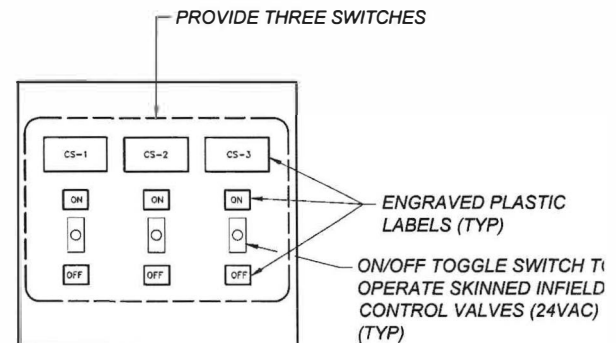


SYSTEM PROGRAMMING FOR COACH'S SWITCH USE:

IN ORDER FOR THE CONTROL SYSTEM WITH A FLOW SENSOR/MASTER VALVE INSTALLATION TO ASSOCIATE FLOWS WITH A PARTICULAR STATION AND TO DETERMINE THAT THE FLOWS ARE NOT UNAUTHORIZED WHICH MAY RESULT IN A MASTER VALVE SHUT-DOWN, SET UP THE SYSTEM AS FOLLOWS:

1. NAME AN UNUSED STATION ON A FIELD CONTROLLER "COACH'S SWITCH".
2. AT THE CONTROLLER, OR THE CENTRAL BASE STATION, SET THE MAXIMUM FLOW FOR THE COACH'S SWITCH STATION TO A VALUE HIGHER THAN THE EXPECTED FLOW FROM THE SKINNED INFELD ZONE(S) WHEN OPERATING.
3. CREATE A CONTROLLER PROGRAM AS "COACH'S SWITCH PROGRAM 1".
4. SET THE PROGRAM 'START TIME' FOR THE EARLIEST TIME THE COACH'S SWITCH MAY BE USED, E.G. 8:00 AM.
5. SET THE PROGRAM 'RUN TIME' FOR THE MAXIMUM LENGTH OF TIME THAT THE COACH'S SWITCH MAY BE USED, E.G. 8:00 AM TO 6:00 PM = 10 HOURS.
6. SET THE PROGRAM 'DAY SCHEDULE' FOR THE DAYS THAT THE COACH'S SWITCH MAY BE USED.
7. CONSIDER CREATING ADDITIONAL COACH'S SWITCH PROGRAMS (2, 3, ETC.) TO COVER NIGHT GAMES, WEEKEND SCHEDULES OR OTHER SPECIAL EVENTS IF DIFFERENT FROM THE STANDARD PROGRAM.

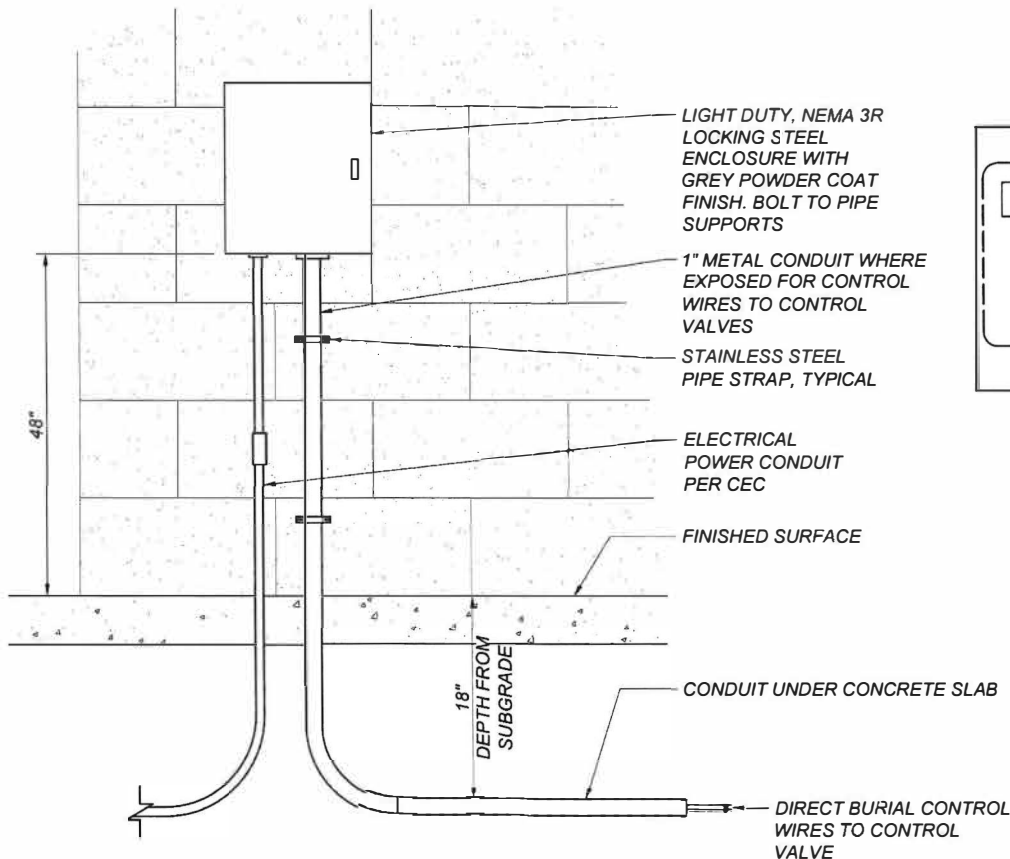

NOTE:

CONFIRM FIELD LABEL DESCRIPTION WITH OWNER PRIOR TO FABRICATION

INTERIOR BOARD LAYOUT

NOT TO SCALE