Attachment to Addendum No.3

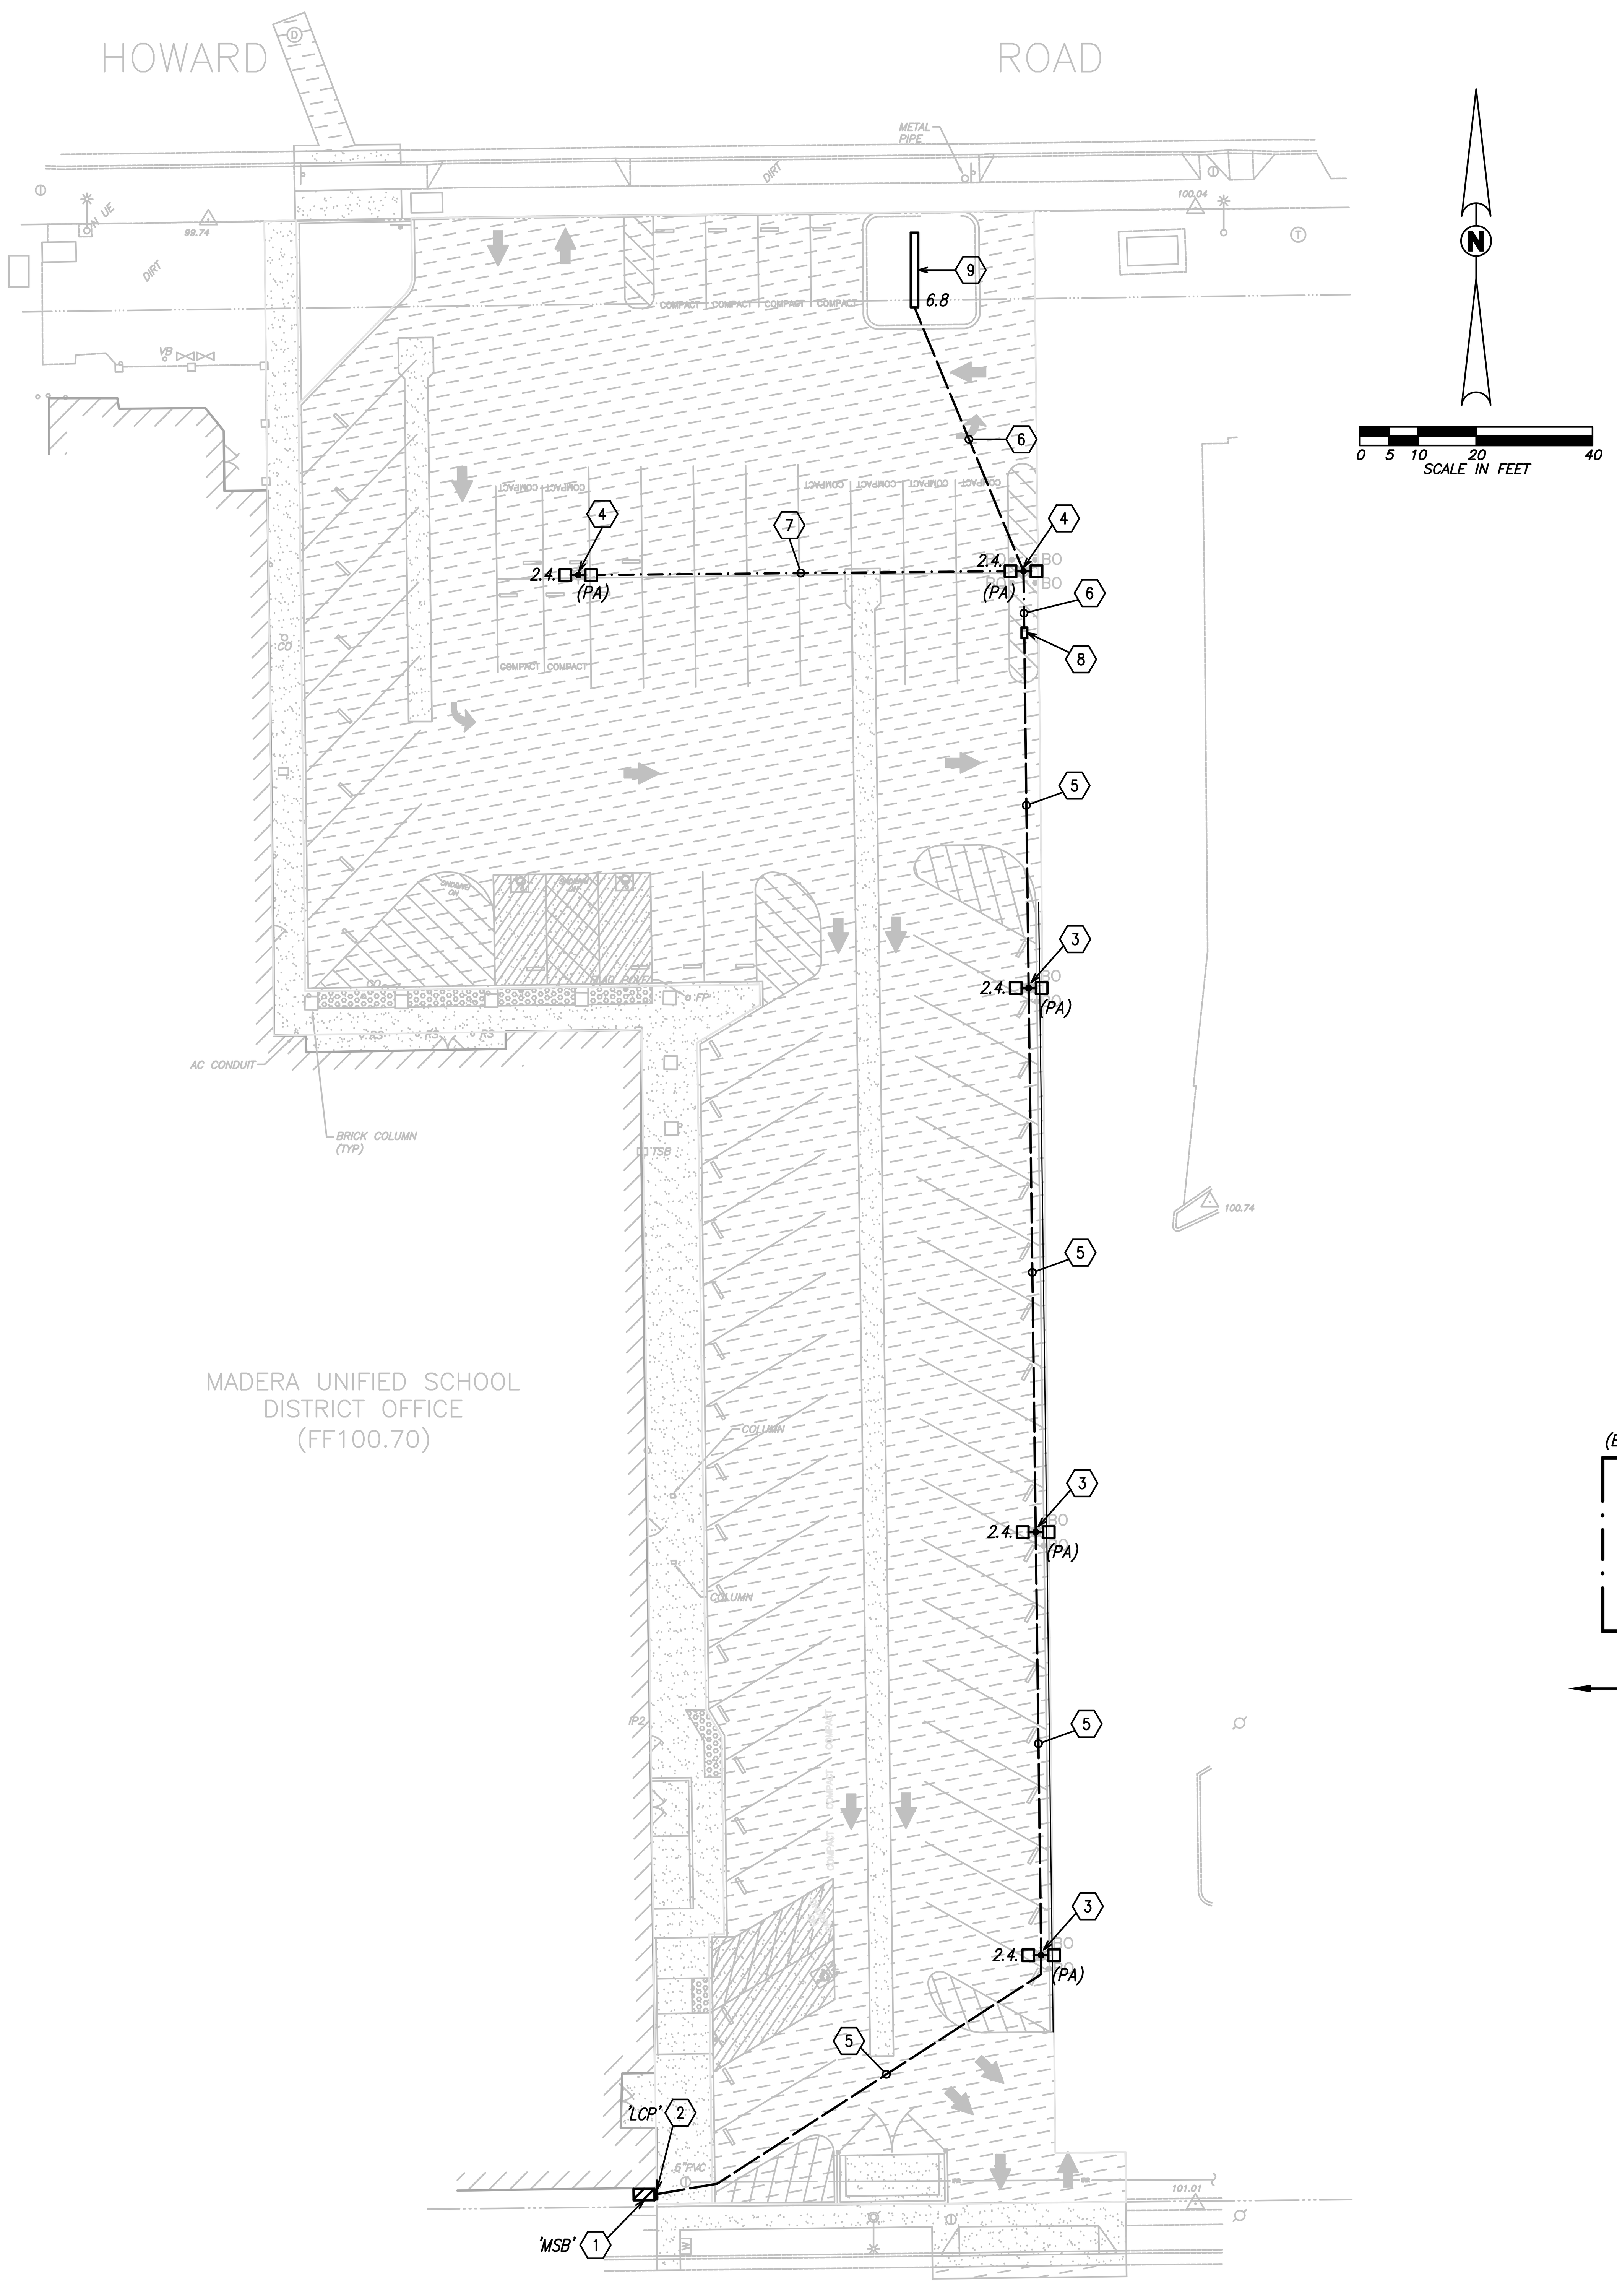

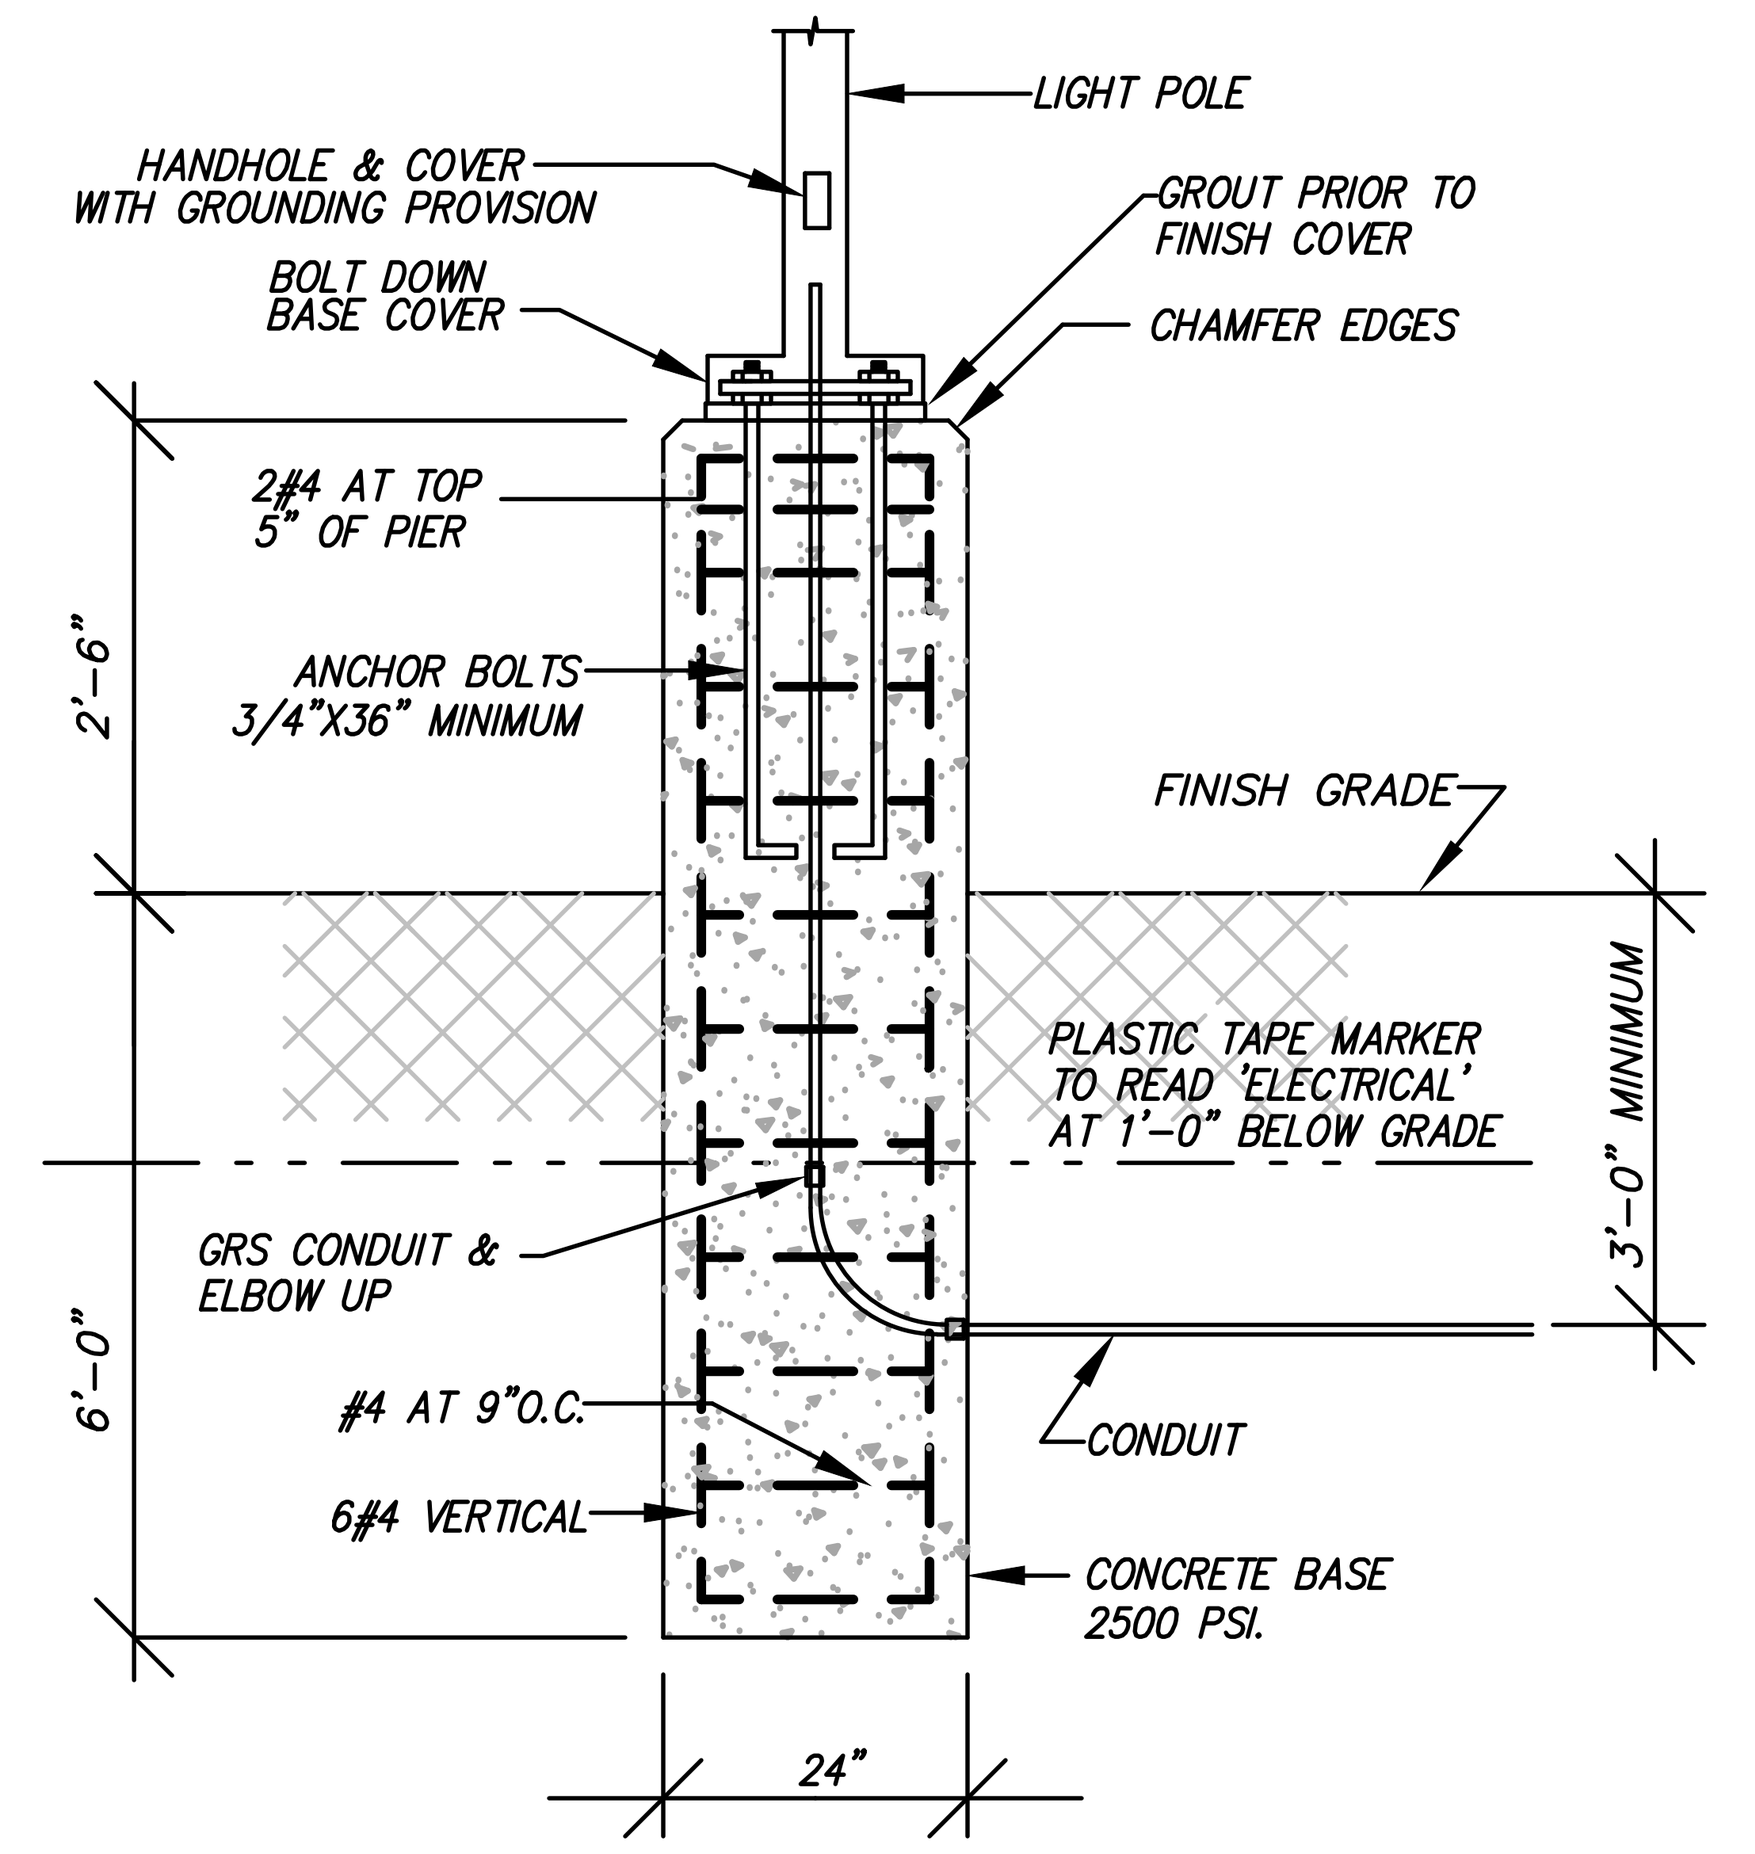

TYPICAL LIGHT POLE BASE DETAIL

NOT TO SCALE

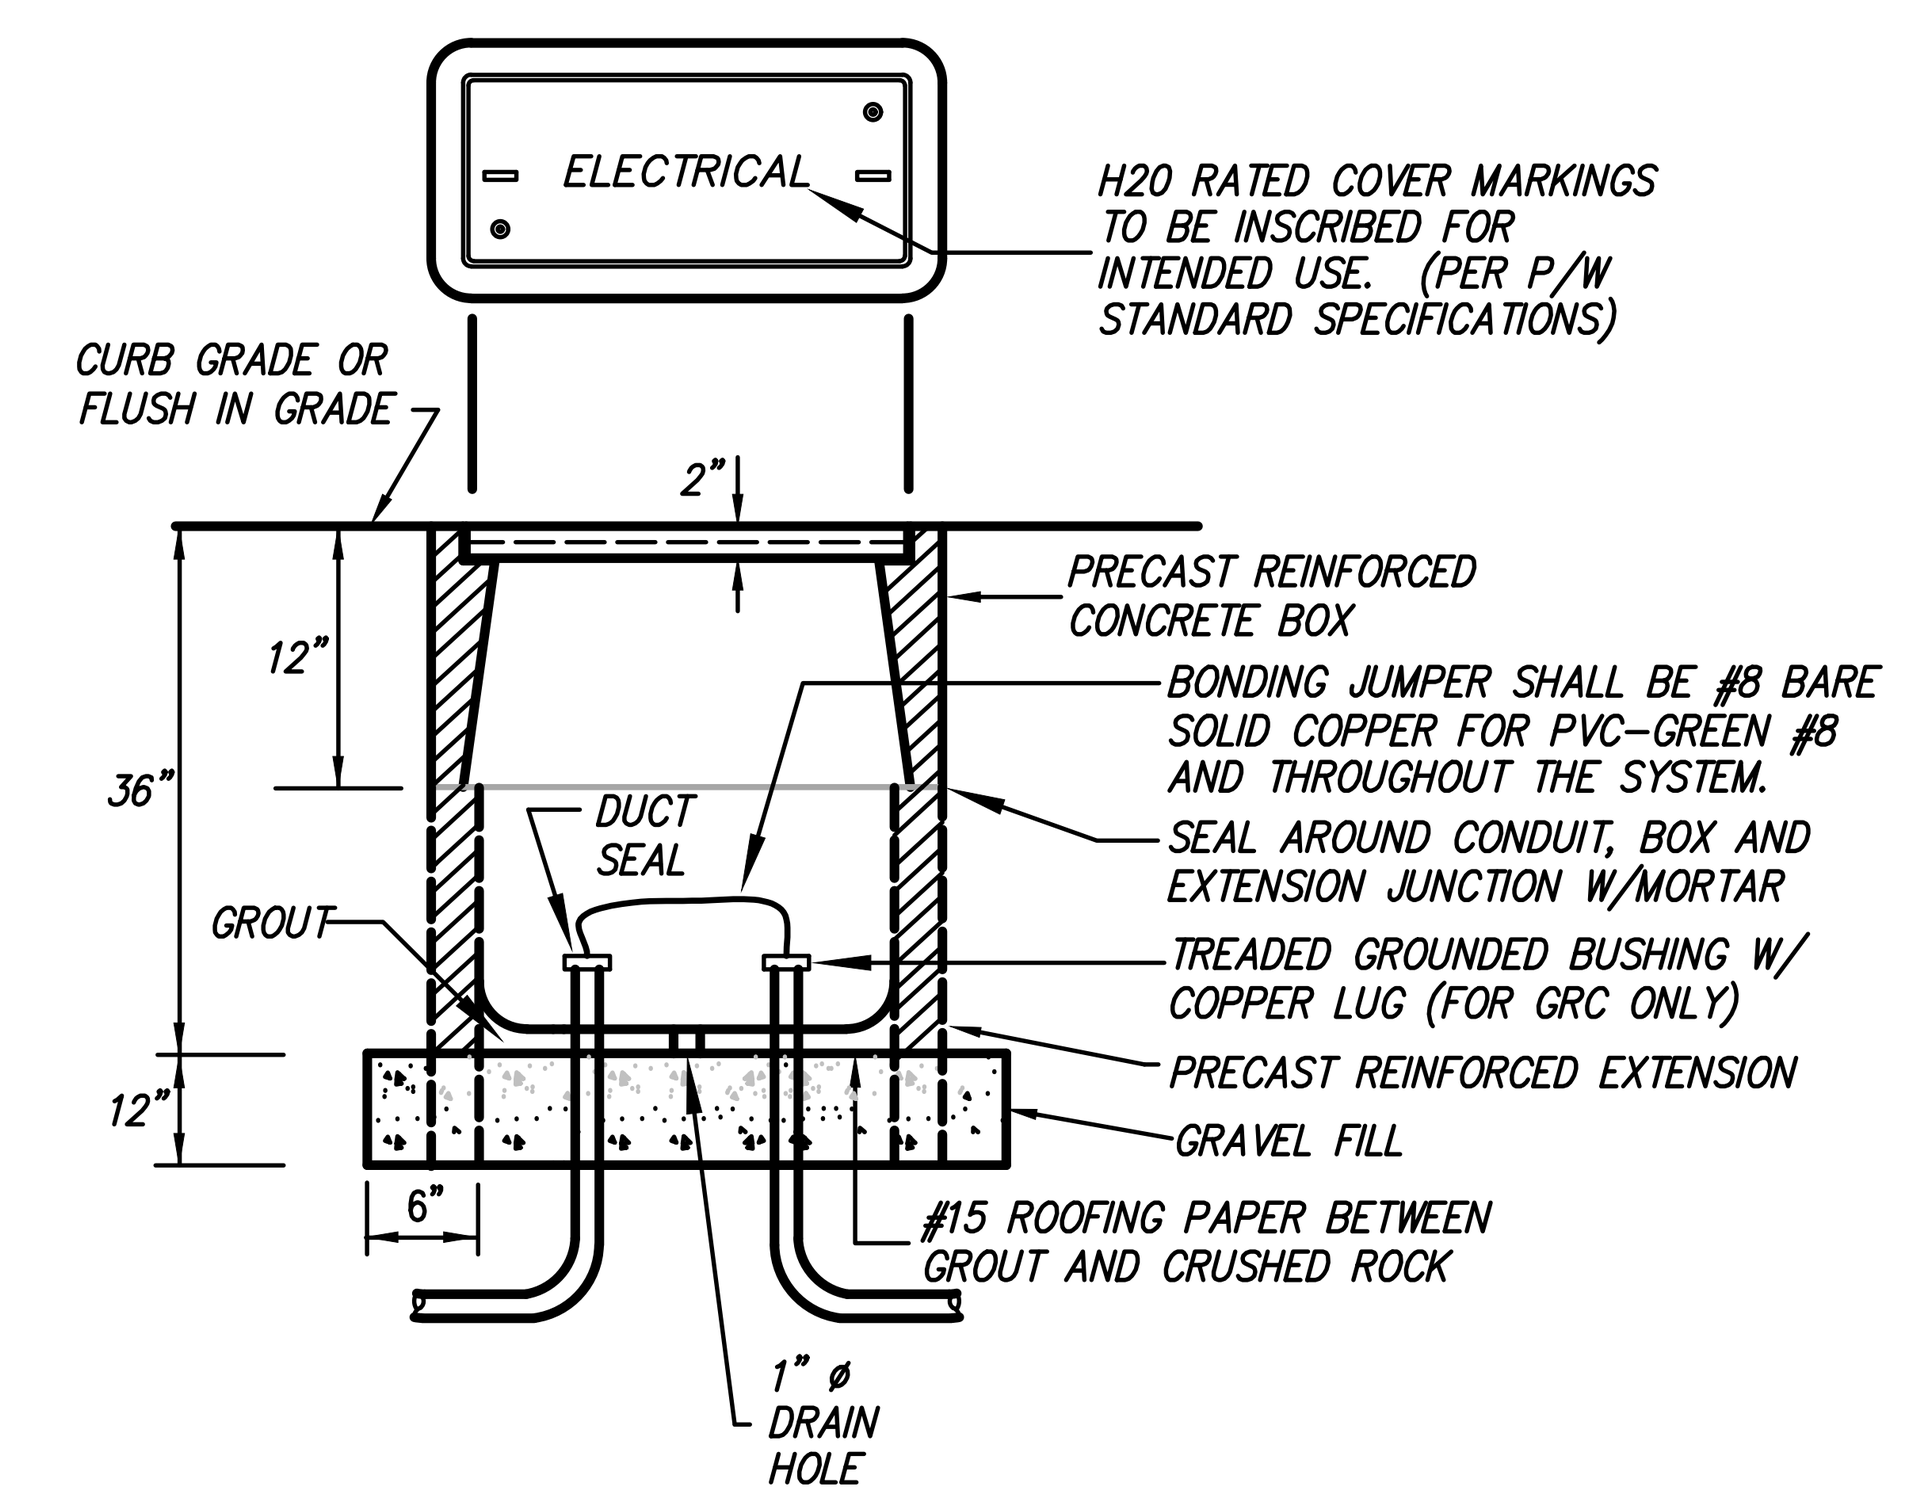

TYPICAL PULL BOX DETAIL

NOT TO SCALE

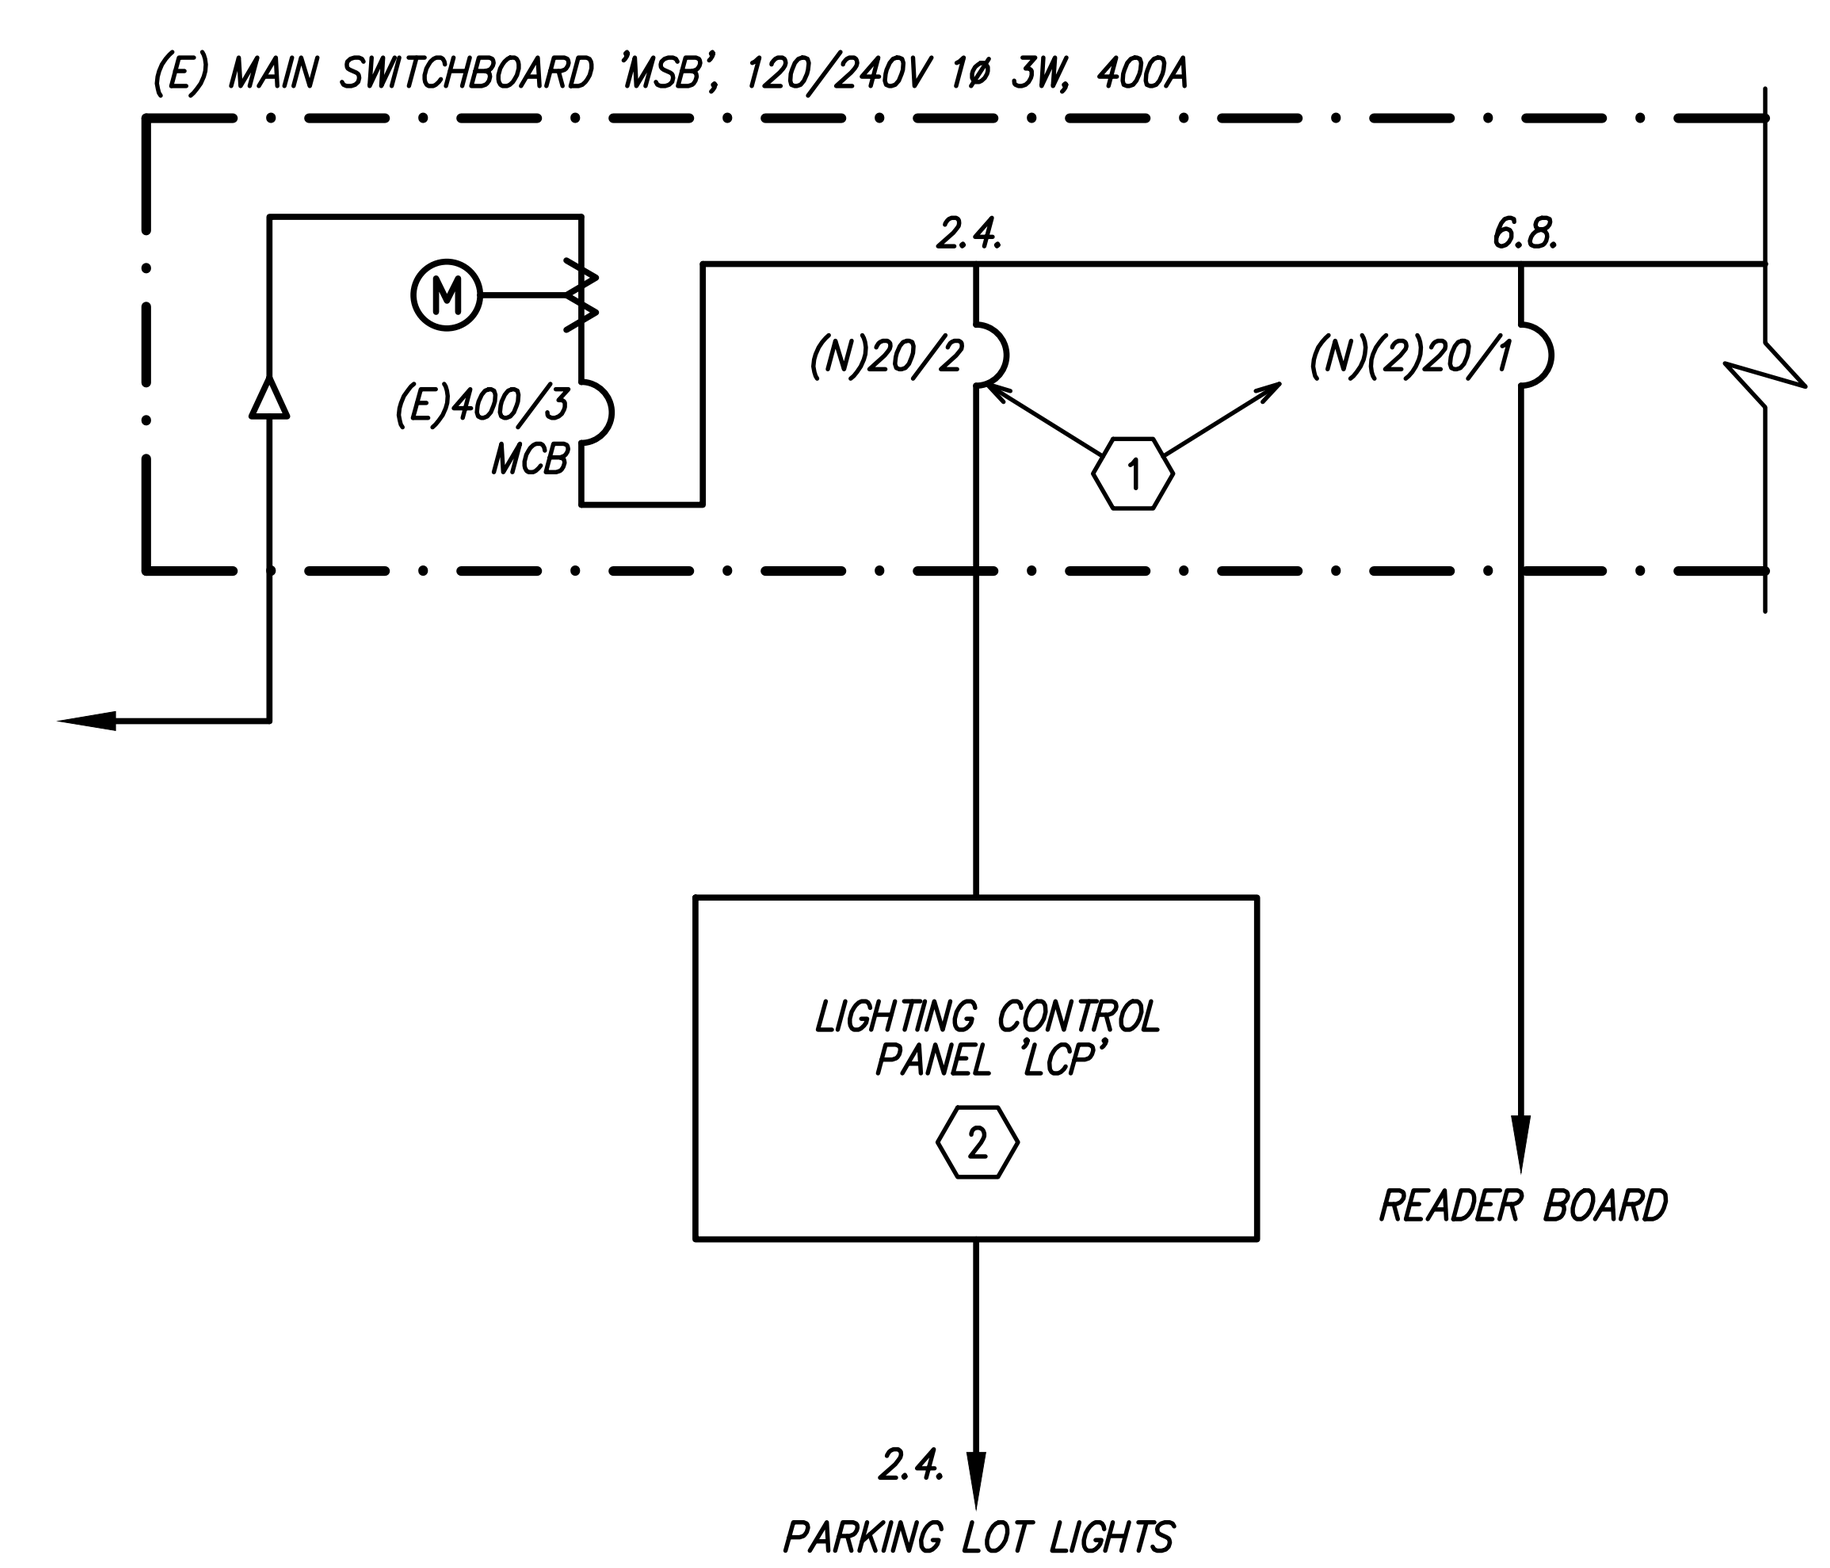

SINGLE LINE DIAGRAM

NOT TO SCALE

ELECTRICAL KEYNOTES:

1. EXISTING MAIN SWITCHBOARD 'MSB', 120/240V 1ø 3W, 400A. PROVIDE (2) 20A/1P & (1) 20A/2P CIRCUIT BREAKERS, 22 KAIC.
2. PROVIDE LIGHTING CONTROL PANEL IN WEATHERPROOF CAN. GREENGATE #LK8-TPRC-(2)TPR208
3. PROVIDE DOUBLE HEAD PARKING LOT FIXTURE, POLE, & CONCRETE BASE.
4. REPLACE EXISTING DOUBLE HEAD PARKING LOT FIXTURE WITH NEW POLE FIXTURE & CONCRETE BASE.
5. PROVIDE 1-1/2"C-4#10, 2#10 NEUT., 2#10 GND.
6. EXISTING CONDUIT. PROVIDE NEW 2#10, 2#10 NEUT., 1#10 GND.
7. EXISTING CONDUIT. PROVIDE NEW 2#10, 1#10 GND.
8. PROVIDE 12"x22"x24"D H-20 RATED CONCRETE PULL BOX TO INTERCEPT EXISTING CONDUIT.
9. CONNECT READER BOARD POWER, (2) 120V 1ø

GENERAL ELECTRICAL NOTES:

1. ALL WORK AND MATERIAL SHALL CONFORM TO 2022 CODES AND ORDINANCES. INTENTION OF THESE PLANS AND SPECIFICATIONS TO COVER ALL THINGS REQUIRED TO PROVIDE COMPLETE AND OPERATIVE SYSTEMS. THE CONTRACTOR IS TO FURNISH LABOR, MATERIAL, TRANSPORTATION, EQUIPMENT, MISCELLANEOUS SERVICES, ETC., REQUIRED TO ACCOMPLISH THIS RESULT. ANYTHING WHICH MAY BE REASONABLY CONSTRUED AS A NECESSARY PART OF THE INSTALLATION IS TO BE INCLUDED, WHETHER SPECIFICALLY SHOWN OR MENTIONED. NOTHING IN THESE PLANS OR SPECIFICATIONS IS TO BE CONSTRUED TO PERMIT WORK NOT CONFORMING TO THESE CODES.
2. ALL EQUIPMENT TO HAVE TESTING LABORATORY LABEL ATTACHED (U.L., C.S.A., ETC.)
3. UNDERGROUND ELECTRICAL RUNS SHALL HAVE MINIMUM 24" COVER. SAND BACK FILL ABOVE CONCRETE ENCASEMENT IF NATIVE SOIL IS NOT ACCEPTABLE FOR BACKFILL. COMPACTION TEST REQUIRED AS PER GENERAL CONDITION SPECIFICATIONS OF EARTH WORK SECTION OR MINIMUM OF 92% COMPACTION REQUIRED IN PAVED AREAS, 87% IN LANDSCAPE AREAS, PROVIDE CONCRETE ENCASEMENT AND WARNING TAPE.
4. ALL EXPOSED WIRING SHALL BE IN GALVANIZED RIGID STEEL CONDUIT. PVC SCH 40 MAY BE USED FOR UNDERGROUND, WITH GALVANIZED RIGID STEEL ELBOWS & RISERS, ALL UNDERGROUND CONDUIT TO BE CONCRETE ENCASED IN 3" ENVELOPE, 1500 PSI
5. CONDUCTORS SHALL BE COPPER, TYPE THHN/THWN FOR SIZE NO. 6 AWG. AND SMALLER, TYPE THWN FOR SIZE LARGER THAN NO. 6 AWG.
6. VERIFY EXACT EQUIPMENT & POLE LOCATIONS PRIOR TO ROUGH-IN. THE CONTRACTOR SHALL ARRANGE A MEETING WITH OWNER TO VERIFY EXACT REQUIREMENT OF INSTALLATION.
7. ELECTRICAL ROUTING IS DIAGRAMMATIC ONLY. ACTUAL ROUTING & PHYSICAL CONDITION MAY VARY, CONTRACTOR IS RESPONSIBLE FOR DETERMINING ACTUAL ROUTING AND PROVIDE ALL RECONNECTIONS & ITEMS NECESSARY FOR COMPLETE & OPERATING SYSTEMS. REPAIR OR REPLACE ALL EXISTING ITEMS DAMAGED DURING CONSTRUCTION. VERIFY ALL EXISTING UNDERGROUND UTILITIES PRIOR TO EXCAVATION.
8. ALL NEW 600 VOLT POWER WIRING SHALL BE MEGGER TESTED PRIOR TO ENERGIZATION.
9. ALL SAW CUT & PATCH OF EXISTING CONCRETE PADS SHALL EXTEND TO EXISTING COLD JOINTS.
10. PROVIDE ALL REQUIRED ELECTRICAL DEMOLITION TO REMOVE OLD PARKING LOT LIGHTS, POLES, & CONCRETE BASES, WHETHER SHOWN OR NOTED.

SYMBOL SCHEDULE:

	POLE MOUNTED PARKING LOT LIGHT FIXTURE
	WALL MOUNTED LIGHT FIXTURE
	JUNCTION BOX
	PULL BOX OR CONTROL PANEL AS NOTED
	PANEL BOARD
	EXISTING CONDUIT RUN TO REMAIN
	CONDUIT RUN ABOVE GRADE
	CONDUIT RUN BELOW GRADE
A-2	HOME RUN OF CONDUIT AND WIRING, CIRCUIT NO. 2 TO PANEL 'A'
(E)	EXISTING
(N)	NEW
(TYP.)	TYPICAL

LIGHTING FIXTURE SCHEDULE

TYPE	MANUFACTURER	CATALOG NO.	LAMPS	WATTAGE	VOLTAGE	MOUNTING
(PA)	LUMARK	PRV-P-PA1D-750-U-T4W	LED	93	UNV	CONCRETE BASE

Hardin-Davidson Engineering
356 Pollasky Ave., Suite 200, Clovis, CA 93612
559.323.4995 • www.hardin-davidson.com

REGISTERED PROFESSIONAL ENGINEER
R.J. HARDIN
NO. 9125
ELECTRICAL
STATE OF CALIFORNIA

Blair, Church & Flynn
CONSULTING ENGINEERS

CONSULTANT	REF. & REV.	MADERA UNIFIED SCHOOL DISTRICT		
Blair, Church & Flynn Consulting Engineers 451 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500		PARKING LOT RECONSTRUCTION MADERA UNIFED SCHOOL DISTRICT OFFICE ELECTRICAL PLAN - BASE BID	DR. BY: HDE CH. BY: RJH DATE: 02-20-2025 SCALE AS NOTED	E1.0

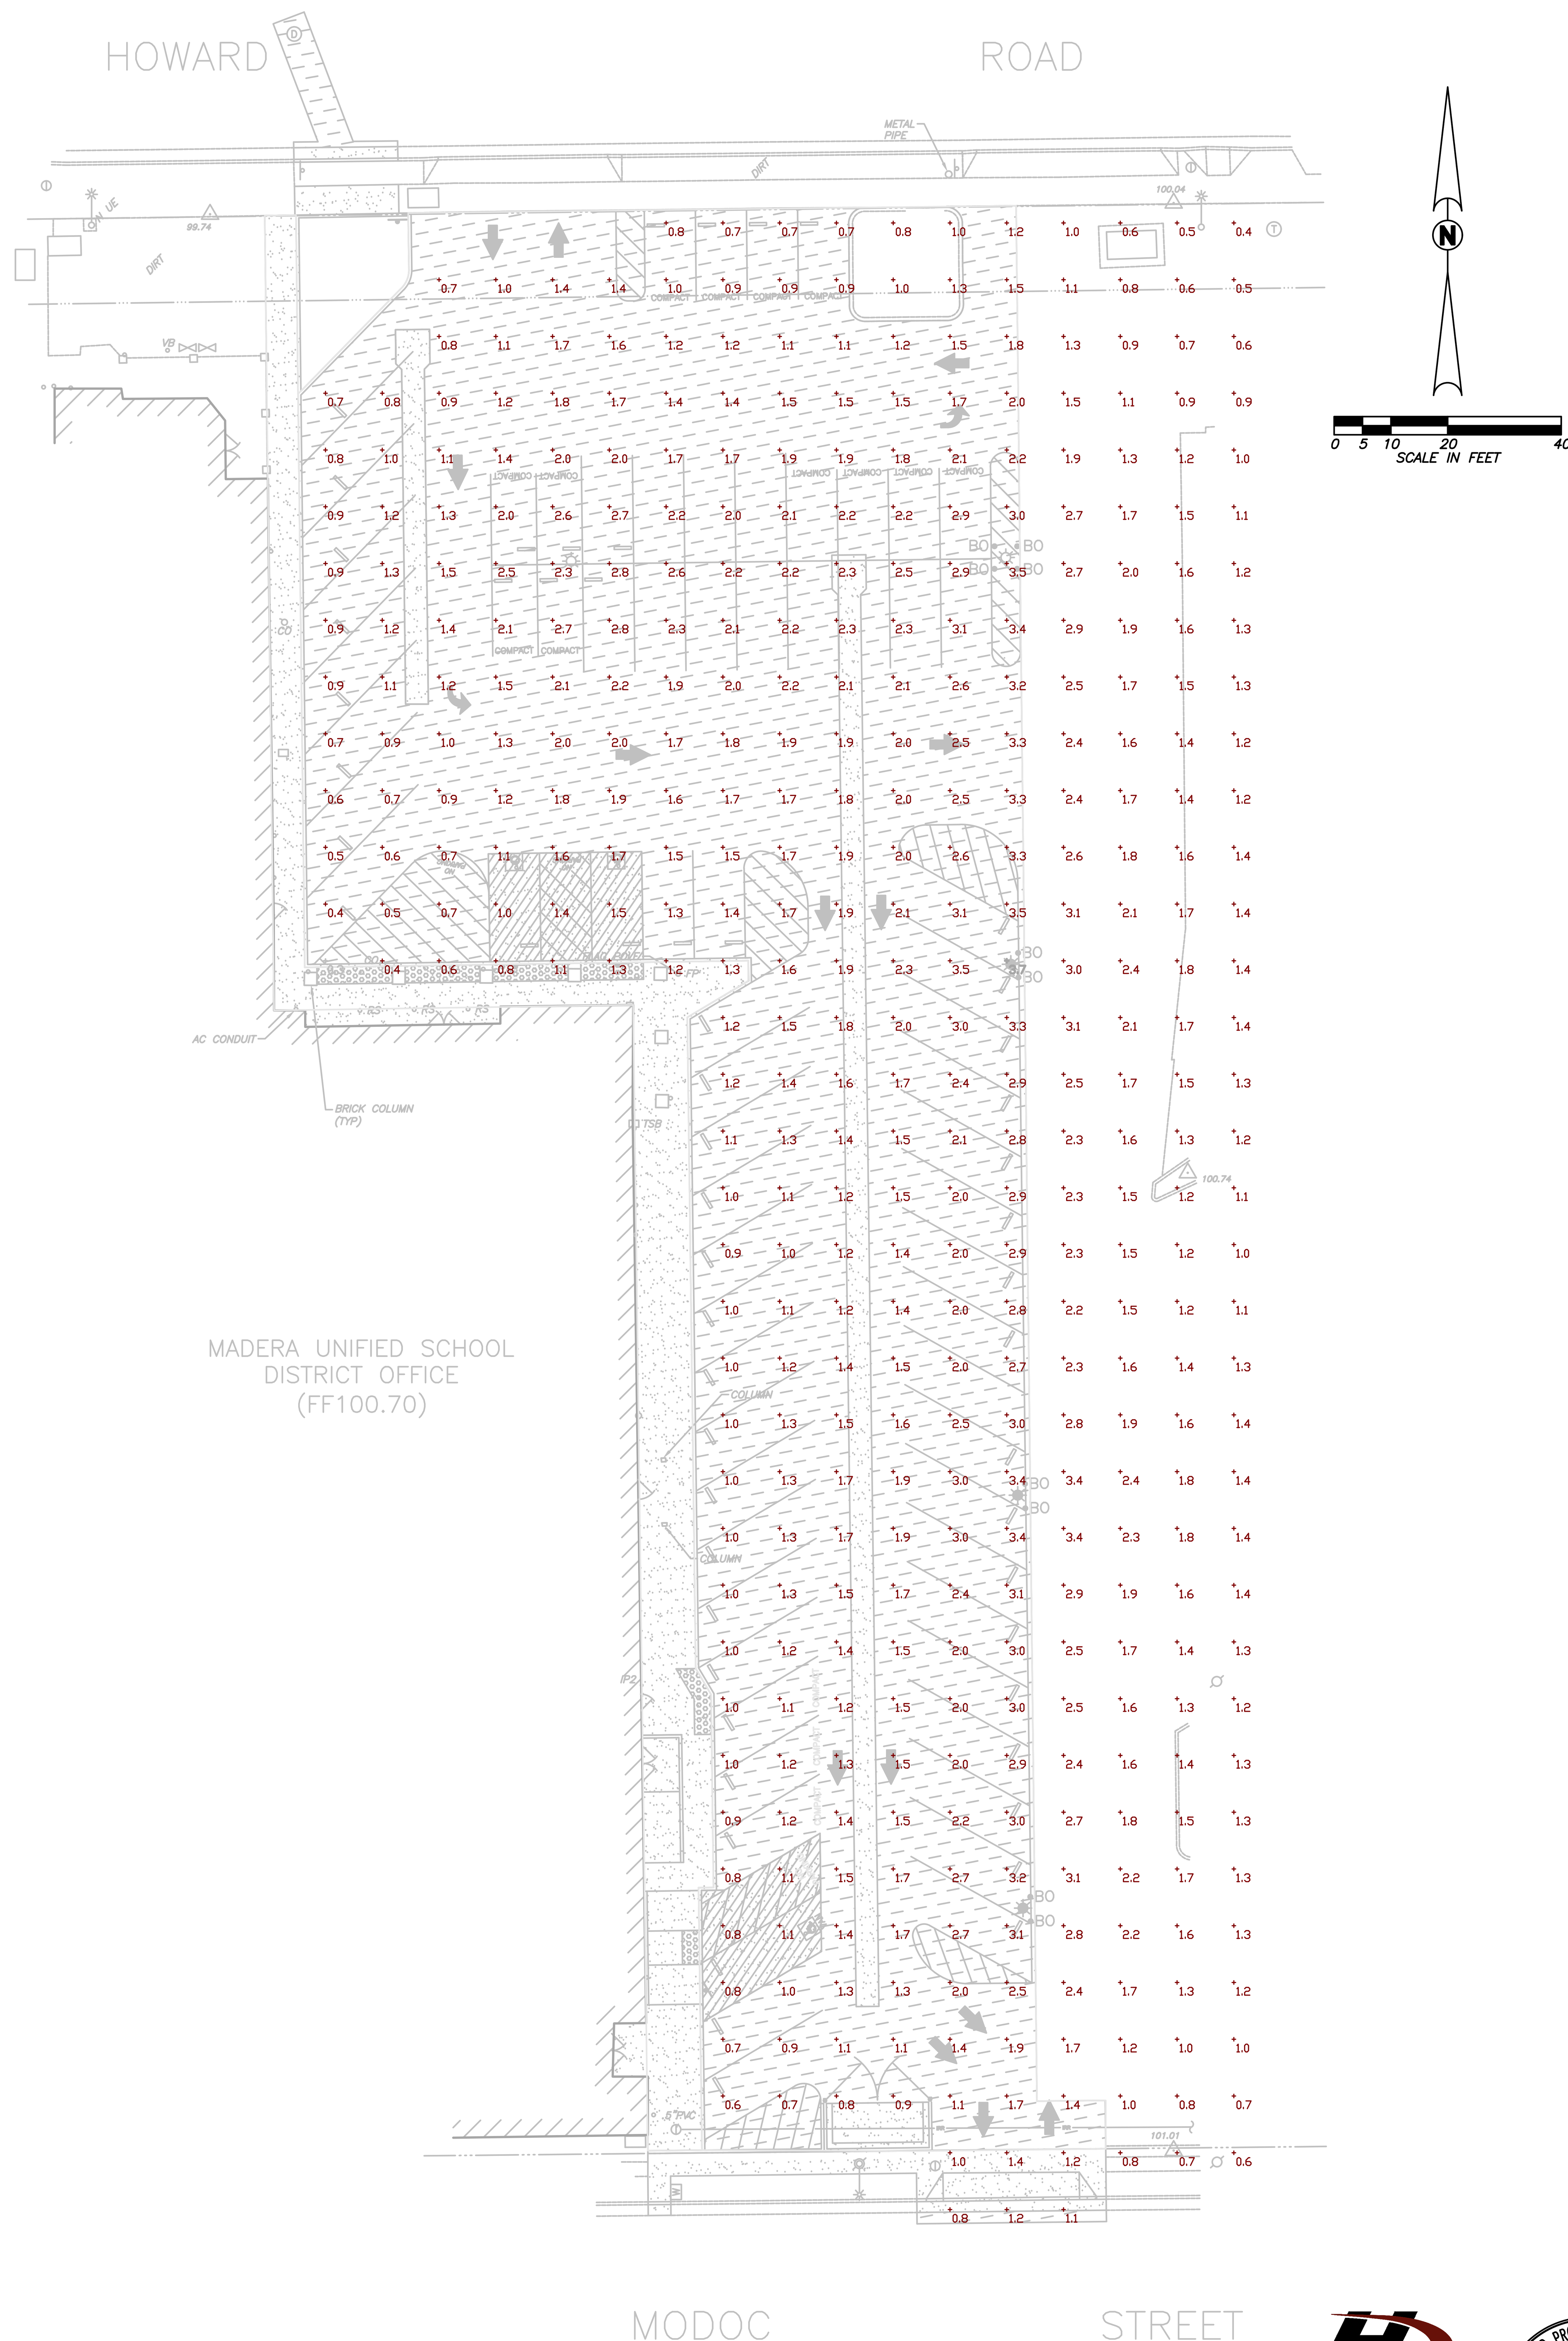

Hardin-Davidson Engineering
356 Pollasky Ave., Suite 200, Clovis, CA 93612
559.323.4995 • www.hardin-davidson.com

REGISTERED PROFESSIONAL ENGINEER
R.J. HARDIN
NO. 9125
ELECTRICAL
STATE OF CALIFORNIA

Blair, Church & Flynn
CONSULTING ENGINEERS

CONSULTANT
Blair, Church & Flynn
Consulting Engineers
451 Clovis Avenue,
Suite 200
Clovis, California 93612
Tel (559) 326-1400
Fax (559) 326-1500

REF. & REV.

MADERA UNIFIED SCHOOL DISTRICT

PARKING LOT RECONSTRUCTION
MADERA UNIFED SCHOOL DISTRICT OFFICE

ELECTRICAL PLAN – PHOTOMETRICS

DR. BY: HDE
CH. BY: RJH
DATE: 02-20-2025
SCALE AS NOTED

E2.0

STATE OF CALIFORNIA

Outdoor Lighting

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE		NRCC-LTO-E
This document is used to demonstrate compliance with requirements in 110.9, 130.0, 130.2, 140.7, and 141.0(b)2L for outdoor lighting scopes using the prescriptive path for nonresidential and hotel/motel occupancies. It is also used to document compliance with requirements in 160.5, 170.2(e)6, 180.1(a) and 180.2(b)4Bv for outdoor lighting scopes using the prescriptive path for multifamily and mixed-use occupancies. Multifamily includes dormitory and senior living facilities.		
Project Name: Madera USD Parking Lot Reconstruction	**Report Page:**	**(Page 1 of 7)**
Project Address: 1902 Howard Rd	**Date Prepared:**	2/20/2025

A. GENERAL INFORMATION

01	Project Location (city)	Madera	04	Total Illuminated Hardscape Area (ft^2)	32101
02	Climate Zone	13			
03	Outdoor Lighting Zone per Title 24 Part 1 10.114 or as designated by Authority Having Jurisdiction (AHJ):				
☐	LZ-0: Very Low - Undeveloped Parkland	☒ LZ-2: Moderate - Urban Clusters	☐	LZ-4: High - Must be reviewed by CA Energy Commission for Approval	
☐	LZ-1: Low - Rural Areas	☐ LZ-3: Moderately High - Urban Areas			
05	Occupancy Types within Project				
● All Other Occupancies					

B. PROJECT SCOPE

This table includes outdoor lighting systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in 140.7 / 170.2(e)6 or 141.0(b)2L / 180.2(b)4Bv for alterations.

My Project Consists of:

01	02	
☒ New Lighting System	Must Comply with Allowances from 140.7 / 170.2(e)6	
☐ Altered Lighting System	Is your alteration increasing the connected lighting load (Watts)? ◯ Yes ◯ No	
03	04	05
% of Existing Luminaires Being Altered[1]	Sum Total of Luminaires Being Added or Altered	Calculation Method
☐ < 10% ☐ >= 10% and < 50% ☐ >= 50%		

Please proceed to Table F. Outdoor Lighting Fixture Schedule to define the project's luminaires.

[1] *FOOTNOTES: % of Existing Luminaires Being Altered = (Sum Total of Luminaires Being Added or Altered / Existing Luminaires within the Scope of the Permit Application) x 100.*

STATE OF CALIFORNIA

Outdoor Lighting

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE		NRCC-LTO-E
Project Name: Madera USD Parking Lot Reconstruction	**Report Page:**	**(Page 2 of 7)**
	Date Prepared:	2/20/2025

C. COMPLIANCE RESULTS

Results in this table are automatically calculated from data input and calculations in Tables F through N. Note: If any cell on this table says "COMPLIES with Exceptional Conditions" refer to Table D. Exceptional Conditions for guidance or see applicable Table referenced below.

Calculations of Total Allowed Lighting Power (Watts) 140.7 / 170.2(e)6 or 141.0(b)2L / 180.2(b)4Bv												Compliance Results			
01		02		03		04		05		06		07		08	09
General Hardscape Allowance 140.7(d)1 / 170.2(e)6 (See Table I)	+	Per Application 140.7(d)2 / 170.2(e)6 (See Table J)	+	Sales Frontage 140.7(d)2 (See Table K)	+	Ornamental 140.7(d)2 / 170.2(e)6 (See Table L)	+	Per Specific Area 140.7(d)2 / 170.2(e)6 (See Table M)	OR	Existing Power Allowance 141.0(b)2L / 180.2(b)4Bv (See Table N)	=	**Total Allowed** (Watts)	≥	**Total Actual** (Watts)	**07 must be >= 08**
956	+	---	+	---	+	---	+	---	OR	---	=	956	≥	930	COMPLIES
Shielding Compliance (See Table G for Details)															N/A
Controls Compliance (See Table H for Details)															COMPLIES

D. EXCEPTIONAL CONDITIONS

This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

E. ADDITIONAL REMARKS

This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

Section 130.2(b)

Generated Date/Time: Documentation Software: EnergyPro
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
Report Version: 2022.0.000
Schema Version: rev 20220101
Compliance ID: EnergyPro-7514-0225-1315
Report Generated: 2025-02-20 10:32:10

STATE OF CALIFORNIA

Outdoor Lighting

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE		NRCC-LTO-E
Project Name: Madera USD Parking Lot Reconstruction	**Report Page:**	**(Page 3 of 7)**
	Date Prepared:	2/20/2025

F. OUTDOOR LIGHTING FIXTURE SCHEDULE

For new or altered lighting systems demonstrating compliance with 140.7 / 170.2(e)6 all new luminaires being installed and any existing luminaires remaining or being moved within the spaces covered by the permit application are included in the Table below. For altered lighting systems using the Existing Power method per 141.0(b)2L only new luminaires being installed and replacement luminaires being installed as part of the project scope are included (ie, existing luminaires remaining or existing luminaires being moved are not included). Outdoor lighting attached to multifamily buildings and controlled from the inside of a dwelling unit are included in Table H. and are not included here. All other multifamily outdoor lighting is included here.

Designed Wattage:

01	02		03	04	05	06	07	08	09	10	
Name or Item Tag	Complete Luminaire Description		Watts per luminaire[1, 2]	How is Wattage determined	Total Number Luminaires[2]	Luminaire Status[3]	Excluded per 140.7(a) / 170.2(e)6A	Design Watts	Cutoff Req. > 6,200 initial lumen output 130.2(b) / 160.5(c)1[4]	Field Inspector	
										Pass	Fail
PA	93w LED Pole Head	☐ Linear	93	Mfr. Spec	10	New	☐	930	NA: < 6200 lumens	☐	☐
Total Design Watts:								930			

* NOTES: Selections with a * require a note in the space below explaining how compliance is achieved.
EX: Luminaire is lighting a statue; EXCEPTION 2 to 130.2(b)

[1] *FOOTNOTES: Authority Having Jurisdiction may ask for Luminaire cut sheets to confirm wattage used for compliance per 130.0(c) / 160.5(b)*

[2] *For linear luminaires, wattage should be indicated as W/lf instead of Watts/luminaire. Total linear feet should be indicated in column 05 instead of number of luminaires.*

[3] *Select "New" for new luminaires in a new outdoor lighting project, or for added luminaires in an alteration. Select "Altered" for replacement luminaires in an alteration. Select "Existing to Remain" for existing luminaires within the project scope that are not being altered and are remaining. Select "Existing Reinstalled" for existing luminaires which are being removed and reinstalled as part of the project scope.*

[4] *Compliance with mandatory shielding requirements is required for luminaires with initial lumen output >= 6,200 unless exempted by 130.2(b)/ 160.5(c)*

G. SHIELDING REQUIREMENTS (BUG)

This section does not apply to this project.

Generated Date/Time: Documentation Software: EnergyPro
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
Report Version: 2022.0.000
Schema Version: rev 20220101
Compliance ID: EnergyPro-7514-0225-1315
Report Generated: 2025-02-20 10:32:10

STATE OF CALIFORNIA

Outdoor Lighting

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE		NRCC-LTO-E
Project Name: Madera USD Parking Lot Reconstruction	**Report Page:**	**(Page 4 of 7)**
	Date Prepared:	2/20/2025

H. OUTDOOR LIGHTING CONTROLS

This table demonstrates compliance with controls requirements for all new or altered luminaires installed as part of the permit application. For alteration projects, luminaires which are existing to remain (ie untouched) and luminaires which are removed and reinstalled (wiring only) do not need to be included in this table even if they are within the spaces covered by the permit application.
Outdoor lighting for nonresidential buildings, parking garages and common service areas in multifamily buildings must be documented separately from outdoor lighting attached to multifamily buildings and controlled from the inside of a dwelling unit

Mandatory Controls for Nonresidential Occupancies, Parking Garages & Common Areas in Multifamily Buildings

01	02	03	04	05	
Area Description	Shut-Off 130.2(c)1 / 160.5(c)	Auto-Schedule 130.2(c)2 / 160.5(c)	Motion Sensor 130.2(c)3 / 160.5(c)	Field Inspector	
				Pass	Fail
Parking Lot	Astronomical Timer	Provided	NA: Not permitted by H&LS	☐	☐

[1] *FOOTNOTE: Text has been abbreviated, please refer to Table 160.5-A to confirm compliance with the specific light source technologies listed.*

[2] *Authority having jurisdiction may ask for cutsheets or other documentation to confirm compliance of light source.*

[3] *Recessed luminaires marked for use in fire-rated installations, and recessed luminaires installed in non-insulated ceilings are excepted from ii and iii.*

Generated Date/Time: Documentation Software: EnergyPro
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
Report Version: 2022.0.000
Schema Version: rev 20220101
Compliance ID: EnergyPro-7514-0225-1315
Report Generated: 2025-02-20 10:32:10

STATE OF CALIFORNIA

Outdoor Lighting

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE		NRCC-LTO-E
Project Name: Madera USD Parking Lot Reconstruction	**Report Page:**	**(Page 5 of 7)**
	Date Prepared:	2/20/2025

I. LIGHTING POWER ALLOWANCE (per 140.7 / 170.2(e))

	01				
This table includes areas using allowance calculations per 140.7 / 170.2(e). General Hardscape Allowance is per Table 140.7-A/Table 170.2-R while "Use it or lose it" Allowances are per Table 140.7-B /Table 170.2-S. Indicate which allowances are being used to expand sections for user input. Luminaires that qualify for one of the "Use it or lose it" allowances shall not qualify for another "Use it or lose it" allowance. Outdoor lighting attached to multifamily buildings and controlled from the inside of a dwelling unit are included in Table H. and are not included here. All other multifamily outdoor lighting is included here.	☒ General Hardscape Allowance Table I (below)	"Use it or lose it" Allowance (select all that apply) (select all that apply)			
		☐ Per Application Table J	☐ Sales Frontage Table K	☐ Ornamental Table L	☐ Per Specific Area Table M

Calculated General Hardscape Lighting Power Allowance per Table 140.7-A for Nonresidential & Hotel/Motel

02	03	04	05	06	07	08	09
Area Description	Area Wattage Allowance (AWA)			Linear Wattage Allowance (LWA)			Total General AWA + LWA (Watts)
	Illuminated Area (ft^2)	Allowed Density (W/ft^2)	Area Allowance (Watts)	Perimeter Length (lf)	Allowed Density (W/lf)	Linear Allowance (Watts)	
Parking Lot	32101	0.019	609.9	971	0.2	145.6	756
Initial Wattage Allowance for Entire Site (Watts):							200
Instances of Initial Wattage Allowance (LZ 0 only)[1]							
Total General Hardscape Allowance (Watts):							956

J. LIGHTING ALLOWANCE: PER APPLICATION

This section does not apply to this project.

K. LIGHTING ALLOWANCE: SALES FRONTAGE

This section does not apply to this project.

L. LIGHTING ALLOWANCE: ORNAMENTAL

This section does not apply to this project.

Generated Date/Time: Documentation Software: EnergyPro
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
Report Version: 2022.0.000
Schema Version: rev 20220101
Compliance ID: EnergyPro-7514-0225-1315
Report Generated: 2025-02-20 10:32:10

STATE OF CALIFORNIA

Outdoor Lighting

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE		NRCC-LTO-E
Project Name: Madera USD Parking Lot Reconstruction	**Report Page:**	**(Page 6 of 7)**
	Date Prepared:	2/20/2025

M. LIGHTING ALLOWANCE: PER SPECIFIC AREA

This section does not apply to this project.

N. EXISTING CONDITIONS POWER ALLOWANCE (alterations only)

This section does not apply to this project.

O. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION

Selections have been made based on information provided in this document. If any selection has been changed by permit applicant, an explanation should be included in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and can be found online

Form/Title
NRCI-LTO-E - Must be submitted for all buildings

P. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

Selections have been made based on information provided in this document. If any selection has been changed by permit applicant, an explanation should be included in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and must be completed through an Acceptance Test Technician Certification Provider (ATTCP). For more information visit: http://www.energy.ca.gov/title24/attcp/providers.html

Form/Title	Systems/Spaces To Be Field Verified
NRCA-LTO-02-A - Must be submitted for all outdoor lighting controls except for alterations where controls are added to <= 20 luminaires.	Parking Lot;

Generated Date/Time: Documentation Software: EnergyPro
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
Report Version: 2022.0.000
Schema Version: rev 20220101
Compliance ID: EnergyPro-7514-0225-1315
Report Generated: 2025-02-20 10:32:10

STATE OF CALIFORNIA

Outdoor Lighting

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE		NRCC-LTO-E
Project Name: Madera USD Parking Lot Reconstruction	**Report Page:**	**(Page 7 of 7)**
Project Address: 1902 Howard Rd	**Date Prepared:**	2/20/2025

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Richard J. Hardin	Documentation Author Signature:
Company: Hardin-Davidson Engineering	Signature Date: 2025-02-20
Address: 356 Pollasky Ave., Suite 200	CEA/ HERS Certification Identification (if applicable): E9125
City/State/Zip: Clovis CA 93612	Phone: 559-323-4995

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

1. The information provided on this Certificate of Compliance is true and correct.
2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer)
3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: Richard J. Hardin	Responsible Designer Signature:
Company: Hardin-Davidson Engineering	Date Signed: 2025-02-20
Address: 356 Pollasky Ave. Suite 200	License: E9125
City/State/Zip: Clovis CA 93612	Phone: 559-323-4995

Generated Date/Time: Documentation Software: EnergyPro
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
Report Version: 2022.0.000
Schema Version: rev 20220101
Compliance ID: EnergyPro-7514-0225-1315
Report Generated: 2025-02-20 10:32:10

Hardin-Davidson Engineering
356 Pollasky Ave., Suite 200, Clovis, CA 93612
559.323.4995 • www.hardin-davidson.com

REGISTERED PROFESSIONAL ENGINEER
R.J. HARDIN
NO. 9125
ELECTRICAL
STATE OF CALIFORNIA

Blair, Church & Flynn
CONSULTING ENGINEERS

CONSULTANT	REF. & REV.	MADERA UNIFIED SCHOOL DISTRICT	
Blair, Church & Flynn Consulting Engineers 451 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500		PARKING LOT RECONSTRUCTION MADERA UNIFED SCHOOL DISTRICT OFFICE TITLE 24 COMPLIANCE FORMS – OUTDOOR LIGHTING	DR. BY: HDE CH. BY: RJH DATE: 02-20-2025 SCALE AS NOTED E3.0